

**CITY OF WASHINGTON ~ STREET EXCAVATION REQUIREMENTS  
CITY CODE SECTION 505.665**

**FLOWABLE FILL BACKFILL**


**ONE INCH CLEAN ROCK BACKFILL**

**TYPE 1 (MINUS) ROCK BACKFILL**

FIGURE A, SECTION 505.680

FIGURE B, SECTION 505.680

FIGURE C, SECTION 505.680

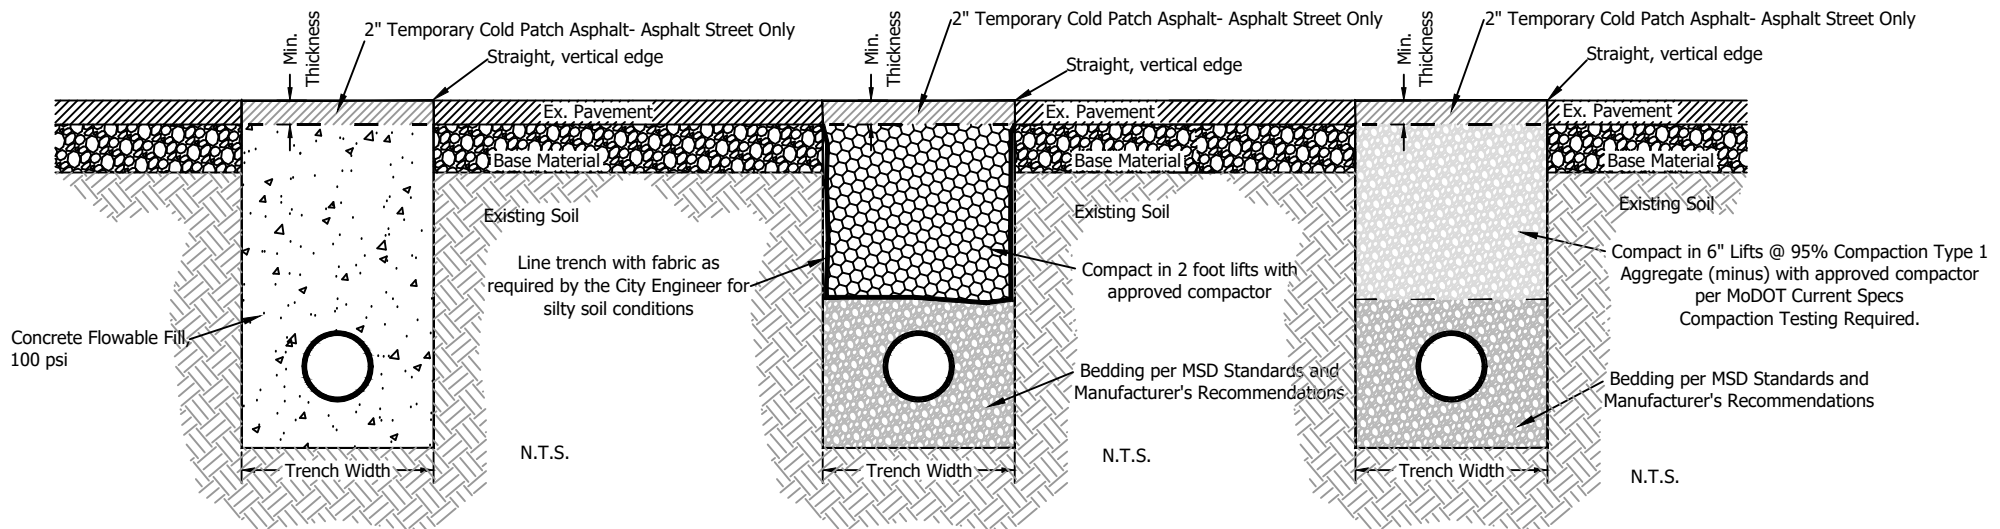

Existing Asphalt Pavement

Minimum Thickness 4" or match existing thickness

Existing Concrete Pavement

Minimum Thickness 6" or match existing thickness

Replace concrete a minimum of 8 feet from joint

Dowel with 5/8" diameter rebar 18" long on 18" centers for concrete equal to or greater than 7" thick

Portland Cement Concrete, 4,000 psi, 28-day compressive strength

Drill 3/4" hole and embed rebar 9" and bond with epoxy or polyester bonding agent per MoDOT Spec Section 1039.30

Portable Plates May Be Required to Protect Trenches  
if work cannot be completed immediately